



FOR AREAS WHERE GROUND WATER WILL COVER THE PRODUCT PIPES, SUBJECT TO SUBSURFACE HYDRO GEOLOGICAL CONSIDERATIONS.

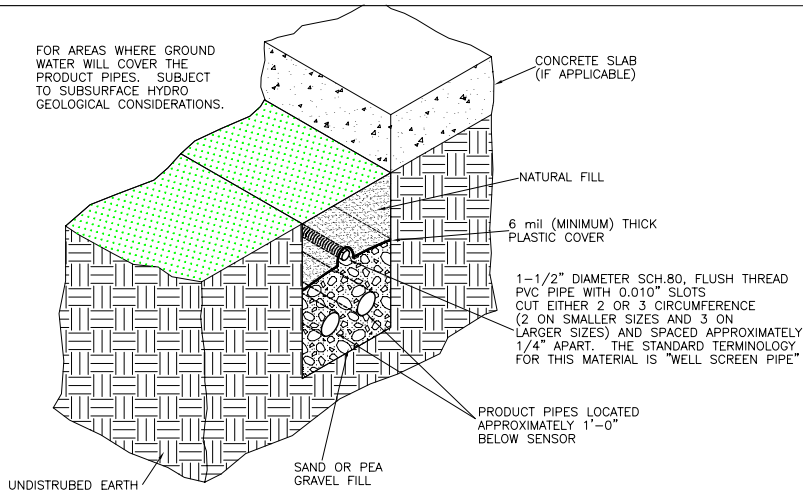


TRENCH DETAIL


FOR ARID AREAS WHERE GROUND WATER WOULD NOT BE EXPECTED TO COVER THE PRODUCT PIPE, SUBJECT TO SUBSURFACE HYDRO GEOLOGICAL CONSIDERATIONS.

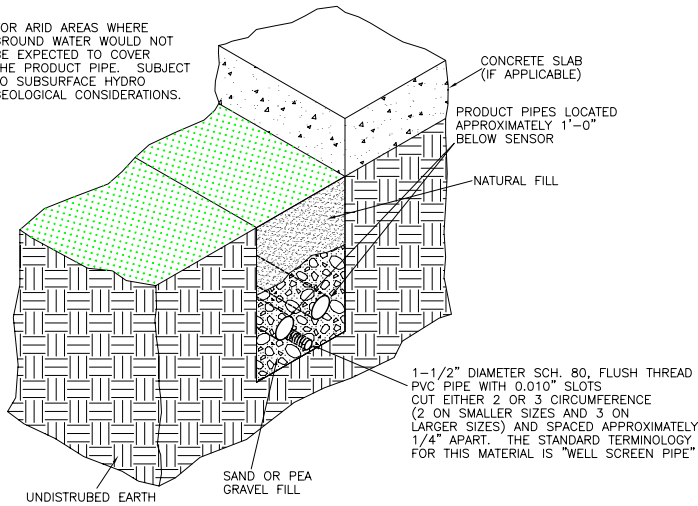


TRENCH DETAIL

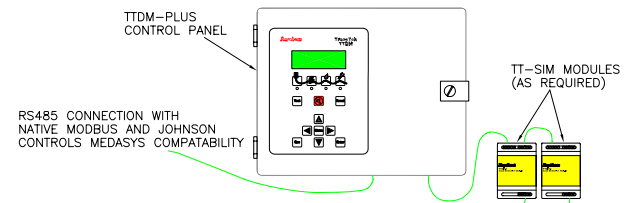


USE OF FLEX HOSE OR JUNCTION BOX DETERMINED BY LEAK DETECTION MANUFACTURER BASED ON SPECIFIC SITE CONDITIONS

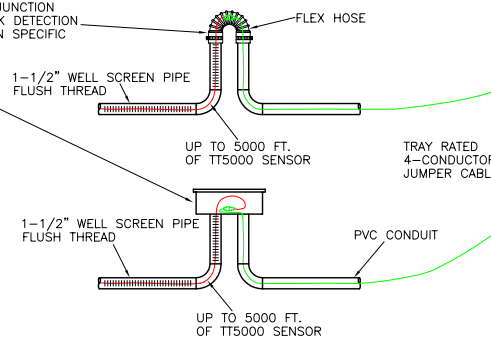

CONTROLS SYSTEM DETAIL

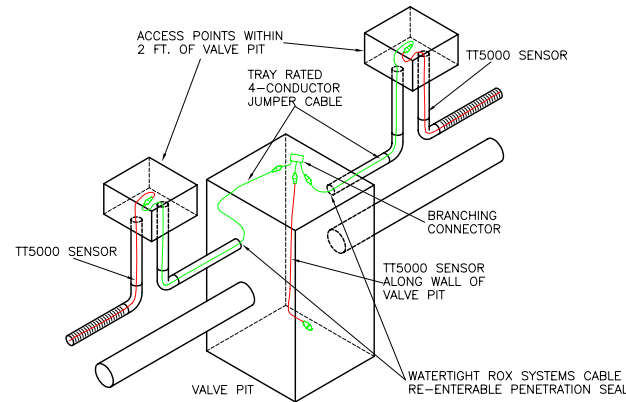

VALVE PIT DETAIL

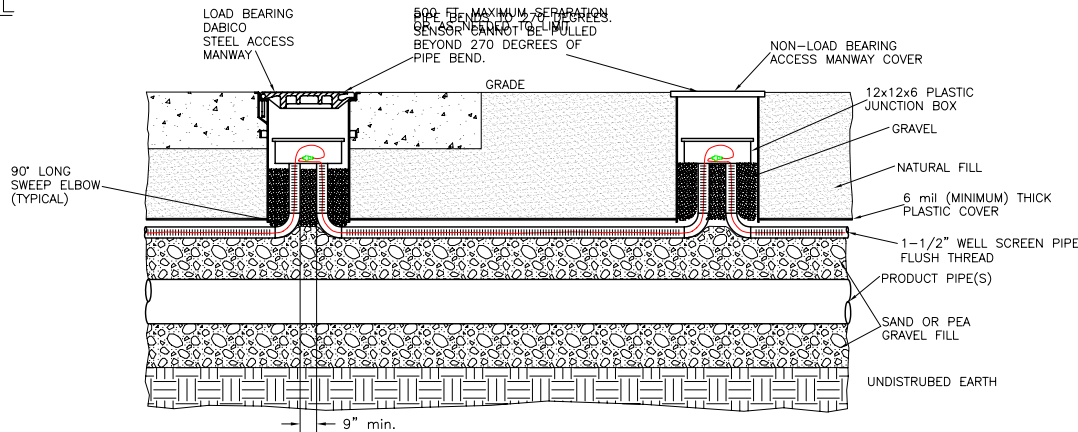

ACCESS RISER DETAIL

PROJECT NAME:
HYDRANT FUELING
SYSTEM
TYPICAL

DESCRIPTION:
DIRECT BURY
LEAK DETECTION
SYSTEM DETAILS DRAWING

REV. 1
ENGINEER:

SCALE: NONE DATE: 3 JUL 2003

DRAWN BY:
R. WARREN



CALIFORNIA DETECTION
SYSTEMS, INC.
17155 Von Karman Avenue
Suite 104
Irvine, CA 92614-0906

— Phone —
(949)223-9800
Fax (949)223-9804